A-WALL-LITE	A-CLNG-LITE	A-CLNG-FIRE	A-CLNG-DIFF	A-ROOF-EXST	A-WALL-BATH	LAYOUT	A-TLSP-BASE	A-PRHT-WALL	A-PART-WALL	A-FULL-WALL	A-WALL-FIRE-FW	A-WALL-FIRE-SB	A-WALL-FIRE-SP	A-WALL-FIRE-SW	A-WALL-FIRE-4F	A-WALL-FIRE-3F	A-WALL-FIRE-2FS	A-WALL-FIRE-2F	A-WALL-FIRE-1FS	A-WALL-FIRE-1F	A-WALL-EXST	A-STRS-BASE	A-ROOM-BASE	A-PATT-BASE	A-OVHD-BASE	A-GRID-BASE	A-GLAZ-BASE	A-FUTR-CASE	A-FLOR-CASE	A-FIXT-CASE	A-EQPM-BASE	A-DOOR-BASE	A-DEMO-BASE	A-COLS-BASE	A-CASE-UPPER	A-CASE-LOWER	A-BLDG-BASE
A-WALL-LITE	A-CLNG-LITE	A-CLNG-FIRE	A-CLNG-DIFF	A-ROOF-EXST	A-WALL-BATH	LAYOUT																																
BLACK	BLACK	BLACK	BLACK	SCR/BLK	BLACK	BLACK*	BLACK	GREEN	BLACK	GREEN	RED	RED	RED	RED	RED	RED	RED	RED	RED	RED	SCR/BLK	GREEN	BLACK	GREEN	GREEN	BLACK	GREEN	GREEN	GREEN	GREEN	BLUE	GREEN	COLD	BLACK	COLD	COLD	SCR/GREEN

DRAWING CREATED: – 2/7/2024 2:01 PM
LAST DRAWING UPDATE: – 2/7/2024 2:01 PM
PLOT DATE: – 5/29/2008 11:03 AM
FILE NAME: – First Floor.dwg
SCALE FACTOR: – 1:96

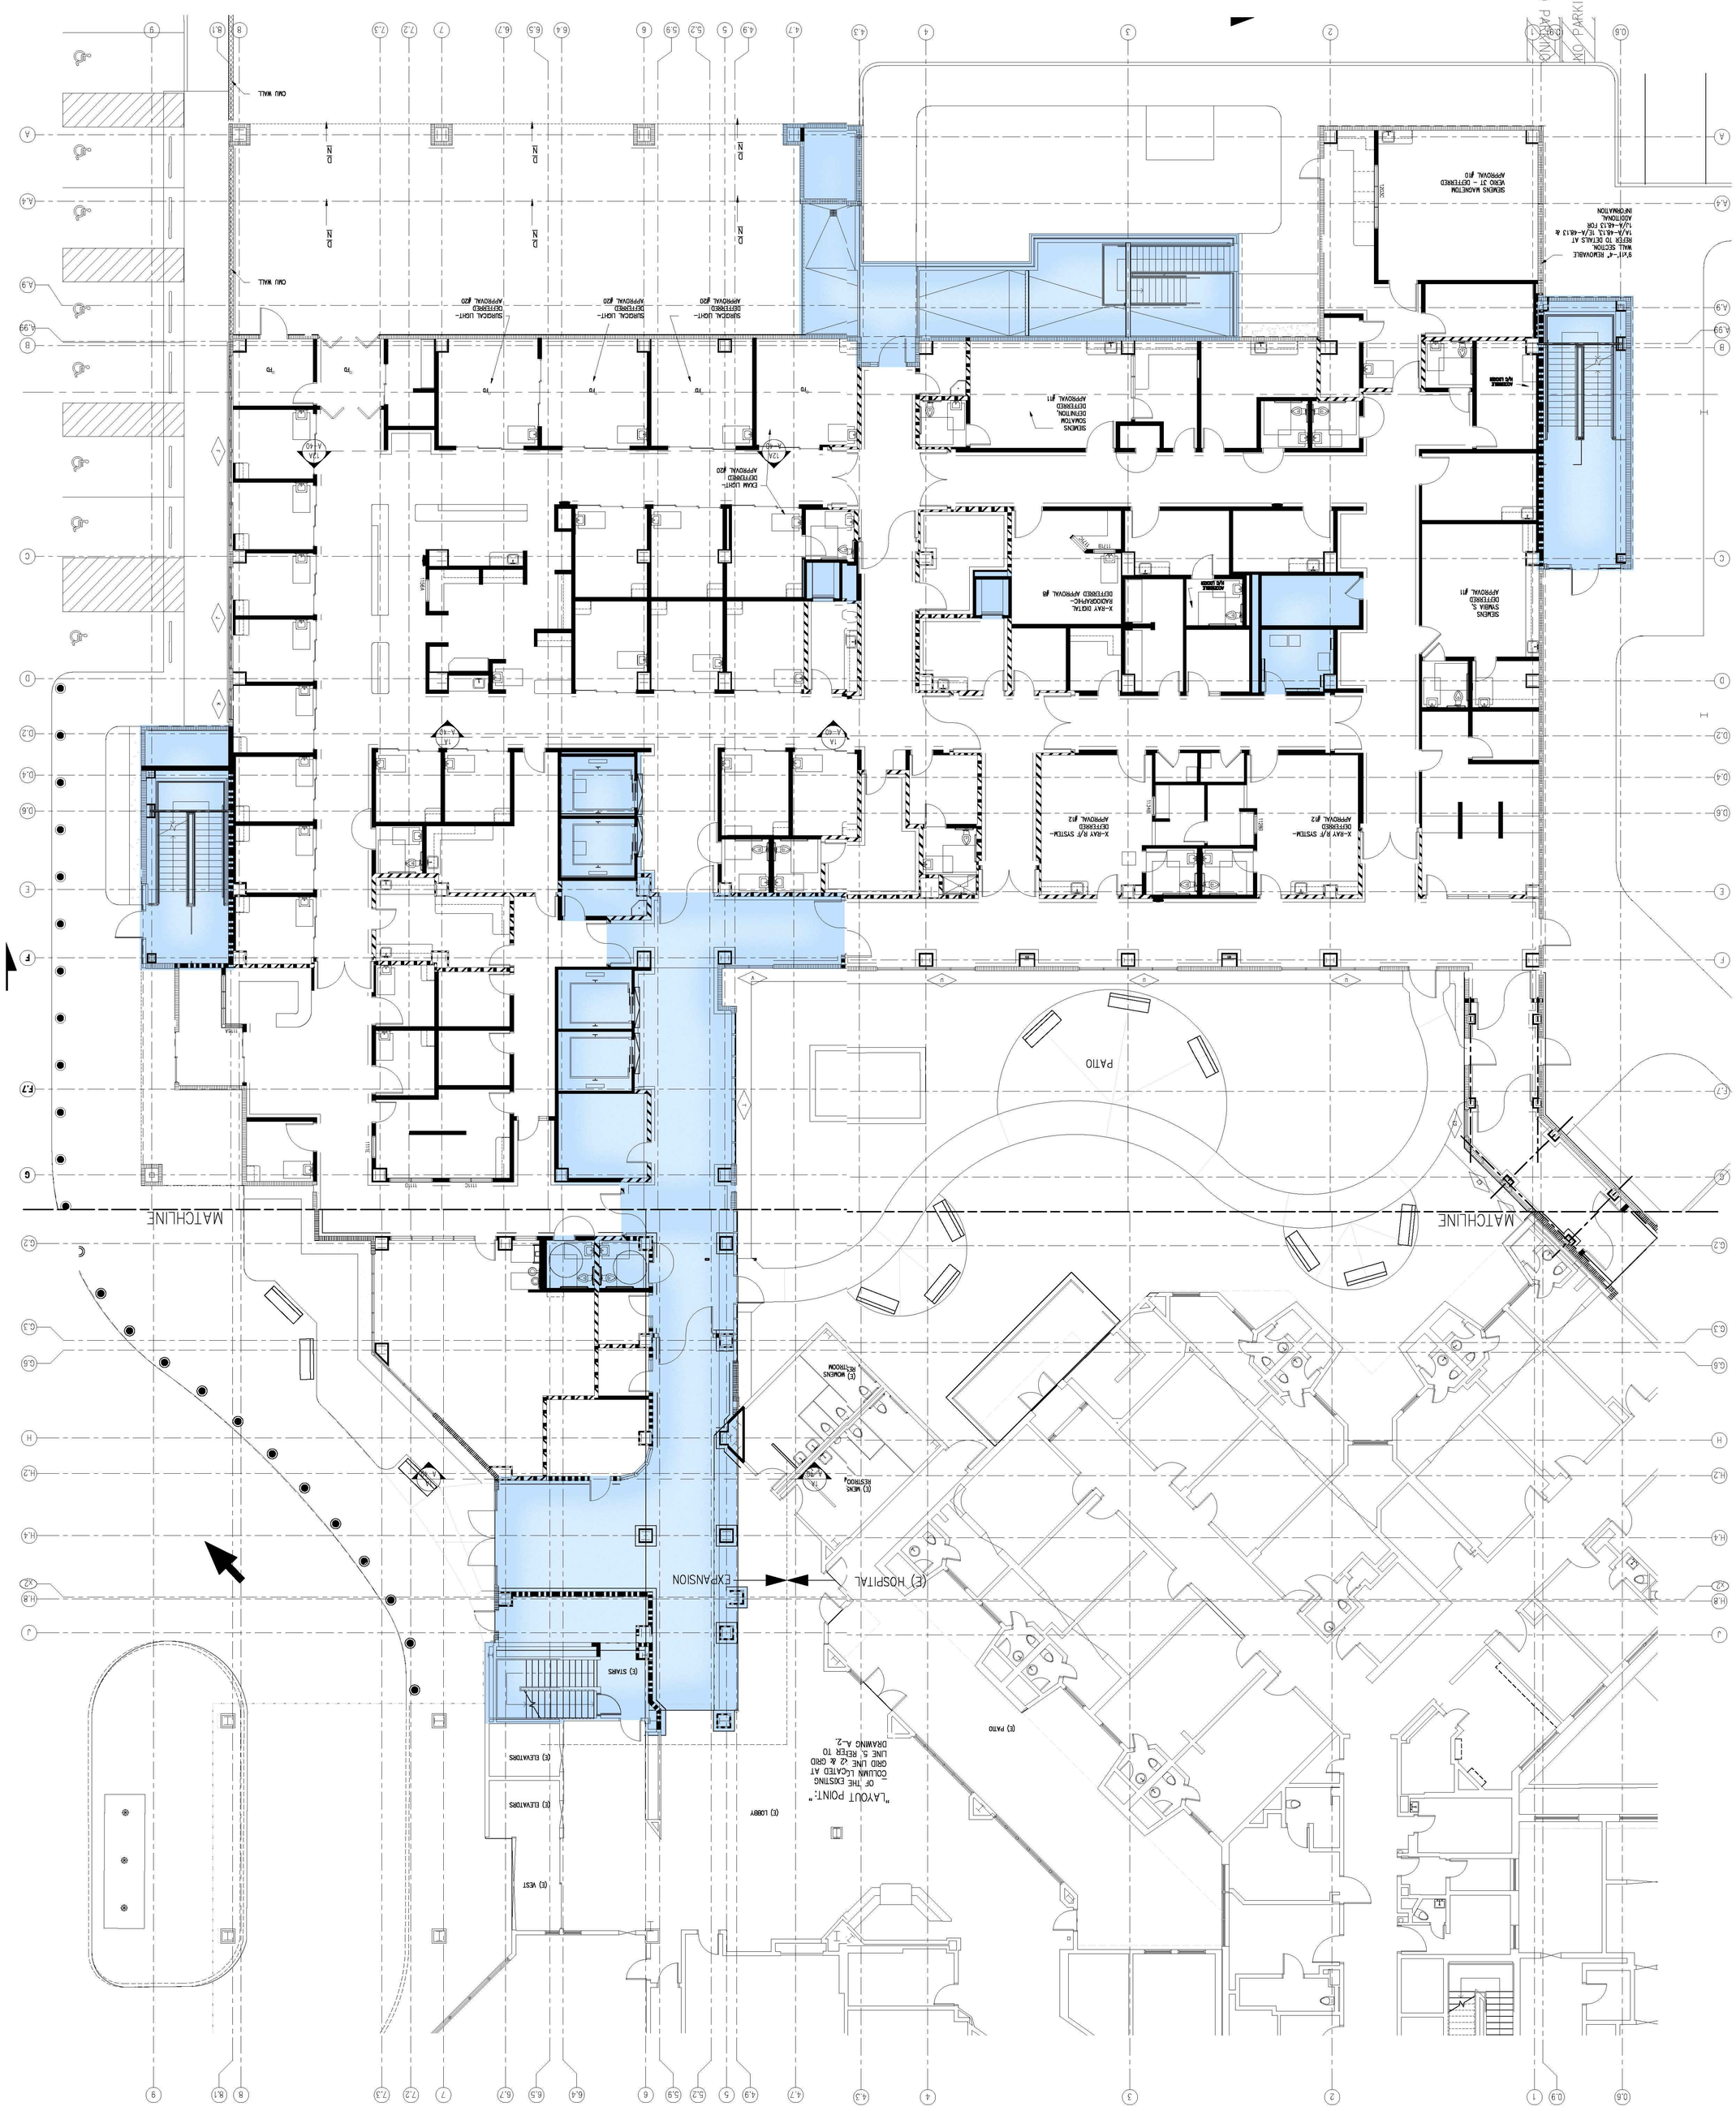

WALL LEGEND:

THIS IS AN ABBREVIATED LEGEND. REFER TO FOR COMPLETE DESCRIPTION AND PRECISE REQUIREMENTS.

WALLS ON THE PLAN DRAWINGS ARE INDICATED BY PLAN SYMBOLS.

2-HOUR RATED FIRE & SMOKE RESISTANT BARRIER WALL: 6"x16 GA STUDS WITH 2 LAYERS 5/8" TYPE 'X' GYP. BD. EA. SIDE. FULL HGT. WITH FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

2-HOUR RATED FIRE & SMOKE RESISTANT SHAFT WALL: 6"x20 GA C-H STUDS WITH 1" FILLER PANELS @ SHAFT SIDE & 2 LAYERS 5/8" TYPE 'X' GYP. BD. @ NA. SIDE. FULL HGT. WITH FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

1-HOUR FIRE BARRIER WALL: 6"x16 GA STUDS WITH 5/8" TYPE 'X' GYP. BD. EA. SIDE. FULL HGT. W/FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

1-HOUR FIRE BARRIER WALL: 6"x16 GA STUDS WITH 5/8" TYPE 'X' GYP. BD. EA. SIDE. FULL HGT. W/FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

SMOKE BARRIER/1-HOUR RATED FIRE BARRIER WALL: 6"x16 GA STUDS WITH 5/8" TYPE 'X' GYP. BD. EA. SIDE. FULL HGT. W/FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

1-HOUR CORRIDOR WALL: 6"x 16 GA STUDS WITH 5/8" TYPE 'X' GYP. BD. EA. SIDE. FULL HGT. W/FULL HGT. SOUND INSULATION.

1-HOUR FIRE-RESISTIVE CONSTRUCTION: 6"x16 GA STUDS WITH 5/8" TYPE 'X' GYP. BD. EA. SIDE. FULL HGT. W/FULL HGT. SOUND INSULATION, UNLESS OTHERWISE MODIFIED.

1-HOUR FIRE-RESISTIVE CONSTRUCTION: 6"x16 GA STUDS WITH 5/8" TYPE 'X' GYP. BD. EXTERIOR SIDE & 5/8" GYP. BD. FULL HGT @ INTERIOR SIDE WITH R-19 THERMAL INSULATION, UNLESS OTHERWISE MODIFIED.

TYPICAL POURED CONCRETE WALL. REFER TO STRUCTURAL DRAWINGS FOR THICKNESS.

FURRING WALL. FIRE RESISTIVE RATING WHERE INDICATED. 1 5/8" STUD FURRING WITH 5/8" GYP. BD. ONE SIDE, UNLESS OTHERWISE MODIFIED.

0 2 4 8 16

NO.	DATE	DESCRIPTION

REVISIONS

ISSUE DATE: 02.02.24
JOB NUMBER: 19031

A1.01

PHASE ONE FIRST FLOOR PLAN PART A

DAVIS STOKES COLLABORATIVE P.C.
DSC ARCHITECTS
7121 CROSSROADS BLVD
BRENTWOOD, TN 37027
TEL (615) 726-0010
MAIL dscinfo@dsccol com
WEB www dsccol com

THIS DOCUMENT CONTAINS INFORMATION THAT IS PROPRIETARY TO DAVIS, STOKES COLLABORATIVE, P.C. THIS DOCUMENT AND/OR IT'S CONTENTS MAY NOT BE REPRODUCED OR DISCLOSED TO OTHERS, EITHER IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN CONSENT OF DAVIS, STOKES COLLABORATIVE, P.C. COPYRIGHT 2018, ALL RIGHTS RESERVED

TULARE LOCAL HEALTHCARE DISTRICT
TULARE TOWER

TULARE, CALIFORNIA

PRELIMINARY NOT FOR CONSTRUCTION